



MASON INDUSTRIES, Inc.

MERCER RUBBER Co.

350 Rabro Drive, Hauppauge, NY 11788  
 Mason- 631/348-0282 • Info@Mason-Ind.com  
 Mercer- 631/582-1524 • Info@Mercer-Rubber.com  
 FAX 631/348-0279




JOB NAME \_\_\_\_\_  
 CUSTOMER \_\_\_\_\_  
 CUSTOMER P.O. \_\_\_\_\_  
 MASON M. \_\_\_\_\_  
 DWG No. \_\_\_\_\_

**EFL250-SS-NSF**

250 psi FULL VACUUM  
 SS BELLOWS  
 EXPANSION  
 JOINT with FIXED  
 and FLOATING  
 FLANGES 150 lb ASA

**ALL COMPONENTS  
 STAINLESS STEEL**

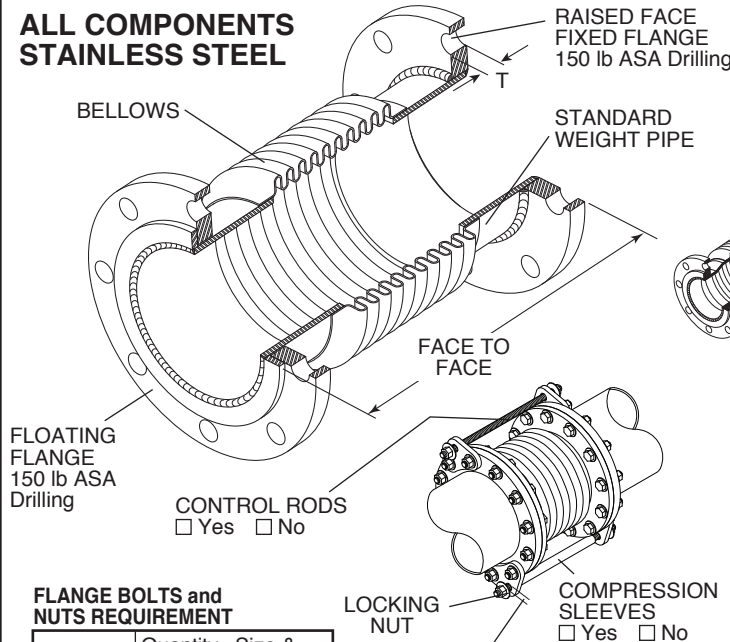

Conforms to UL and ANSI/NSF 61  
 Approved Temperature Range.

Full Vacuum Rating- 30" (762mm) Hg




**WATER QUALITY**  
 DRINKING WATER  
 SYSTEM COMPONENT  
 ANNEX G of ANSI / NSF 61  
 (4RV6)


Our 2" - 4" designs use 5" bellows between reducers for greater stability.

**GUIDE SPACING - Referencing Pipe Diameter "D"**

**Guides and Anchors for Joint located near Anchor**

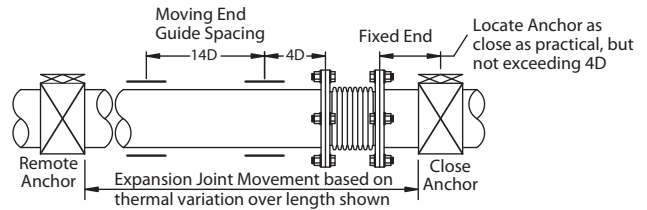

**Guides and Anchors for Joint located between Remote Anchors**

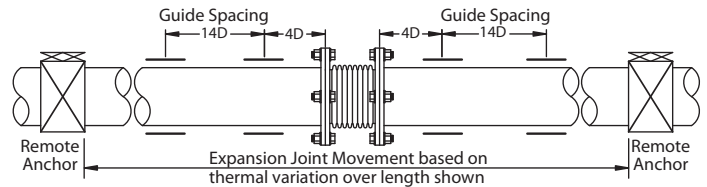

**FLANGE BOLTS and NUTS REQUIREMENT**

Size	Quantity per End	Size & Length
2	16	5/8 x 3 1/2
2 1/2	16	3/4 x 4
3	16	3/4 x 4
4	16	3/4 x 4
5	16	3/4 x 4
6	24	3/4 x 4 1/2
8	24	7/8 x 4 3/4
10	32	1 x 5
12	32	1 1/8 x 5 1/2
14	40	1 1/8 x 5 1/2
16	40	1 1/4 x 6

CONTROL RODS  
 Yes  No

LOCKING NUT

COMPRESSION SLEEVES  
 Yes  No

GAP SETTING (Equal to axial extension for anchored systems or zero for unanchored systems)

**PLATE FLANGES**

Pipe Size (in)	Pipe Size (mm)	Flange Thickness T (in)	Flange Thickness T (mm)
2 thru 4	20 thru 100	3/4	19
5 thru 6	125 thru 150	1	25
8 thru 16	200 thru 406	1 1/4	32

**EFL250-SS-NSF DIMENSIONS AND PRESSURE RATINGS (American & Metric Units)  
 2" (50mm) COMBINED AXIAL MOVEMENT, 1/4" (6mm) LATERAL DEFLECTION**

Size	Pipe Size		Face to Face		Axial Spring Rate		Lateral Spring Rate		Thrust <sup>1</sup> @		Rated Pressure		Ship Wt.	
	(in)	(mm)	(in)	(mm)	(lbs/in)	(kg/cm)	(lbs/in)	(kg/cm)	250 psi (lbs)	17 kg/cm <sup>2</sup> (kg)	@70°F (psi)	@21°C (kg/cm <sup>2</sup> )	(lbs)	(kg)
2	2	50	21	533	1500	268	2040	364	7070	3207	250	17	30	14
2 1/2	2 1/2	65	21	533	1500	268	2040	364	7070	3207	250	17	34	16
3	3	80	21	533	1500	268	2040	364	7070	3207	250	17	36	17
4	4	100	21	533	1500	268	2040	364	7070	3207	250	17	37	17
5	5	125	14 1/4	362	1500	268	2040	364	7070	3207	250	17	38	18
6	6	150	16 1/2	419	1960	350	2450	438	9620	4364	250	17	49	23
8	8	200	17 1/4	438	2040	364	3980	711	15910	7217	250	17	84	39
10	10	250	18	457	2500	446	7790	1391	23760	10777	250	17	116	53
12	12	300	19	483	3530	630	14300	2554	33190	15055	250	17	155	71
14	14	350	20	508	3700	660	17600	3143	44180	20040	250	17	203	92
16	16	400	20 1/2	521	4660	832	30650	5473	56750	25741	250	17	249	113

EFL may be used for 2" Expansion or 2" Compression from neutral length or any combined 2" from neutral. i.e. (+ 1 1/2, - 1/2) (+ 1, - 1) (+ 1/4, - 13/4) etc. Total movement should never exceed 2".

Lower Thrust Forces in proportion at lower pressures, i.e. 100 psi Force = 100/250 x published Thrust. Anchors must resist Thrust Force plus Spring Force. Spring Force is determined by multiplying the joint Spring Rate by its Thermal Movement (in/mm).

EFL's installed in piping systems must be anchored on both sides of the joint. EFL's installed in unanchored piping must have control rods.

When using EFL products in copper or brass water systems, dielectric flanges must be used on each end to prevent leakage from galvanic action.

QTY	SIZE	TAG

QTY	SIZE	TAG